Job Name/Location:			Tag #:		
Date:	For:	File	Resubmit		
PO No.:		Approval	Other	<b>C</b> LG	
Architect:	SC:				
Engr: N	Лесh:				
Rep:					
	roject Manager)				LG
LV241HHV4 Single Zone LGRED° Vertical Air Handle Outdoor Unit (ODU) - LUU240HHV Indoor Unit (IDU)		4	Life's Good		mounts.
Performance:			Operating Range	<u>:</u>	
Cooling:			Outdoor Unit:		
, , ,	0 ~ 24,000 ~ 3		Cooling (°F DB)		5 to 118
SEER / EER   SEER - Seasonal Energy Efficiency Ratio   EER - Energy Efficiency F		/ 12.7	Heating (°F WB)		-13 to 64
SEER - Seasonal Energy Efficiency Ratio EER - Energy Efficiency F Heating:	Ratio		Indoor Unit:		
	0 ~ 27,000 ~ 3	36.000	Cooling (°F WB)		57 to 77
HSPF	2.,000	11.0	Heating (°F DB)		59 to 81
Max heating @ Indoor 70° DB (Btu/h)	າ	0.120	System Data:		
Outdoor 17°F WB		7,400	Refrigerant Type/	Control	R410A / EEV
Outdoor 5°F WB Outdoor -4°F WB		4,250	Refrigerant Charge	e (Ibs.)	4.41
Outdoor -13°F WB		1,590	ODU Sound Pressi	ure Max (Cool / Heat) ±1 dB(A)³	51 / 52
HSPF - Heating Seasonal Performance Factor		.1,570			36 / 34 / 30
Cooling Nominal Test Conditions:         Heating Nominal Test Conditions:           Indoor: 80°F DB / 67°F WB         Indoor: 70°F DB / 60°F Not outdoor: 47°F DB / 43°F           Outdoor: 47°F DB / 43°F         Outdoor: 47°F DB / 43°F	WB		ODU Net / Shipping		33.4 / 144.4 16.8 / 128.5
Electrical:	5				10.07 120.0
Power Supply¹ (V/Hz/Ø)	208-230 /	60 / 1	Fan:	Drond	Ilan / Cinasaa
MOP / MCA (A)	3	0 / 22	ODU / IDU Fan Ty	•	Iler / Sirocco 3 / 3 / 3
Cooling / Heating Rated Amps (A)	8.4	4 / 8.4	Fan Speeds (Fan/		1+1
Compressor(A)		14.5	Fan Quantity (OD	Electronically Commutated Motor (E	
Fan Motor (IDU + ODU) (A)		5 + 1.6	Motor/Drive	•	
Cooling Power Input (Min~Rated~Max, kW)	0.55 ~ 1.89		Maximum ODU A	, ,	2,048
Heating Power Input (Min~Rated~Max, kW)	0.65 ~ 2.25	5 ~ 4.4	IDU Air Volume (H	1/M/L) (CFM) 710	0 / 640 / 480
Locked Rotor Amps (A)		23	Dehumidification		4.2
MOP - Maximum Overcurrent Protection MCA - Minimum Circuit	Ampacity			ic Pressure Operating	01 07
Piping:	0.40		Range (Min~Defa	ult~Max) (in-wg) <sup>11</sup>	0.1~ - ~0.7
Installed Liquid Pipe (in., O.D.) Installed Vapor Pipe (in., O.D.)		Flare Flare	Notes:		
IDU Liquid Connection (in., O.D.)		Flare		voltage: 187V-253V. Jivalent. Lare tested in an anechoic chamber under ISO Standa	
IDU Vapor Connection (in., O.D.)		Flare	3. Sound Pressure levels	are tested in an anechoic chamber under ISO Standa	ird 3745.
Additional Refrigerant (oz./ft.)		0.43	conductor, stranded, shi	elded or unshielded wire and must comply with appli	icable local and
Min/Max. Pipe Length (ft.)	16.4		5. Power wiring cable size	s are tested in an anecnoic chamber under ISO standa ation cable to be minimum 14 American wire gage (A. ielded or unshielded wire and must comply with appli d, the wire must be grounded to the chassis at the ou ze must comply with the applicable local and national is with a dry helium charge. above sea level, with 25 ft. of refrigerant line and a 0 deor and indoor with.	code.
Piping Length (no add'l refrig., ft.)		24.9	7. This data is rated 0 ft. difference between out	above sea level, with 25 ft. of refrigerant line and a 0	ft. level
Max. Elevation (ft.)		98.4	<ol> <li>Must follow installation</li> <li>If the optional low are</li> </ol>	on instructions in the applicable LG installation manua bient wind baffle (ZLABGP04A) is used, one wind baff	al. fle is required for
Features:			each ODU fan. 10. Dehumidification rat	te is based on high speed airflow. U units have ECM fan that automatically adjusts throu e) range. Therefore, there is no default ESP value for th	ughout the FCD
Hot start     Group control     Inverter (variable speed)     Timer (on/off)     Nuto restart     Sleep Mode     IDU	U Drain Pan He ht Quiet Functi J compatible w i F (18k, 24k, 36 els)	ion ith	12. 18k and 24k VAHUs	are supplied with socket adapters for pipe transitions. ssory available in 3kW, 5kW, 8kW, and 10kW capacit g manual for details.	
Required Accessories (sold separately): Controller (Any LG wired remote controller)					
Optional Accessories:  ☐ MultiSITE™ CRC1 - PREMTBVC0 ☐ MultiSITE CRC1+ - PREMTBVC1 ☐ MultiSITE Comm. Mgr PBACNBTR0A ☐ AC Smart 5 - PACS5A000 ☐ ACP 5 - PACP5A000 ☐ Simple Controller - PREMTC00U ☐ Downflow Converged Controller - PREMTC00U ☐ Downflow Converged Controller - PREMTC00U	PRYCB320 ind Baffle (cool F) - ZLABGP04A BkW - ANEH033	8B1 <sup>13</sup>	LCDE	O AUR	CERTIFIED"







for

Job Name/Location:


## LVN241HV4 Single Zone LGRED° Vertical Air Handler Unit




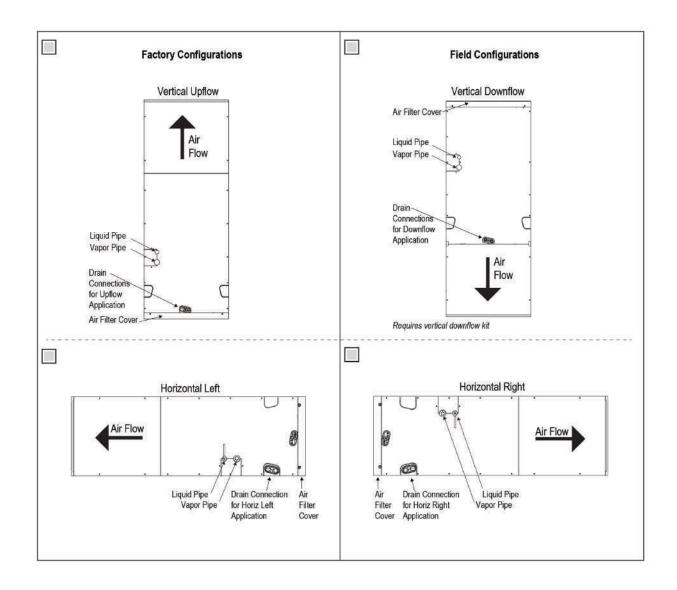



Job Name/Location:


## LUU240HHV Single Zone LGRED° Vertical Air Handler Unit





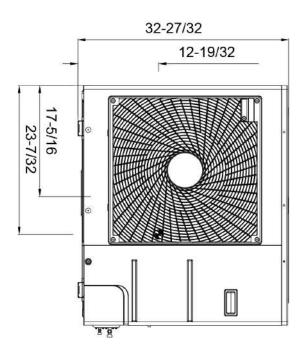

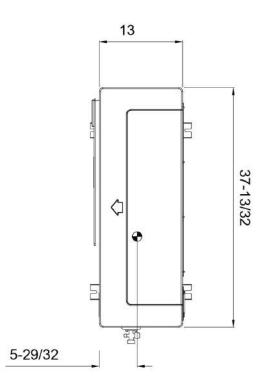



Job Name/Location:


## LVN241HV4 Single Zone LGRED° Vertical Air Handler Unit








PO No.:



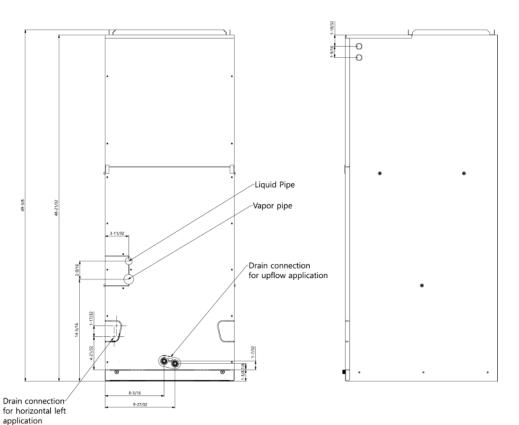

Front View

Side View